



Symaro™

Room Sensors

QFA41...

for relative humidity and temperature
with calibration certificates

- Operating voltage AC 24 V / DC 13.5...35 V
- Signal output DC 0...10 V / 4...20 mA for relative humidity and temperature
- Very high measuring accuracy across the entire measuring range
- Capacitive humidity measurement
- Recalibration service
- Range of use $-40...+70\text{ °C}$ / 0...100 % r. h.

Use

The QFA41... sensor is used in ventilation and air conditioning plants requiring:

- Very high accuracy and reliability for measuring relative humidity and temperature
- Regular recalibration and readjustment of the sensors

Examples:

- Storage and production facilities in the paper, textiles, pharmaceutical, chemical, electronics industries, etc.
- Laboratories
- Hospitals
- Computer centers
- Greenhouses

Type summary

Type reference	Temperature measuring range	Temperature signal output	Humidity measuring range	Humidity signal output	Operating voltage
QFA4160	0...50 °C, –40...+70 °C or –35...+35 °C	Aktive, DC 0...10 V	0...100 %	Aktive, DC 0...10 V	AC 24 V or DC 13.5...35 V
QFA4171	0...50 °C, –40...+70 °C or –35...+35 °C	Aktive, 4...20 mA	0...100 %	Aktive, 4...20 mA	DC 13.5...35 V

Ordering and delivery

When ordering, please give name and type reference, e.g.:

Room sensor **QFA4160**

The circular connector with its screwed plug is delivered uninstalled.

Equipment combinations

The QFA41... is for use with all types of systems and devices that can acquire and handle the sensor's DC 0...10 V or 4...20 mA output signal.

Technical design

Relative humidity

The sensor acquires relative humidity via its capacitive sensing element whose capacitance varies as a function of the relative humidity of the ambient air.

An electronic circuit converts the sensor's signal to a continuous DC 0...10 V or 4...20 mA signal, corresponding to a relative humidity of 0...100 %.

Temperature


The sensor acquires the temperature via its sensing element whose electrical resistance varies according to the temperature of the ambient air.

This variation is converted to an active DC 0...10 V or 4...20 mA output signal, corresponding to a temperature range of 0...50 °C, –35...+35 °C or –40...+70 °C.

The measuring range can be selected.

Burden diagram

Output signal, terminal I1 / I2

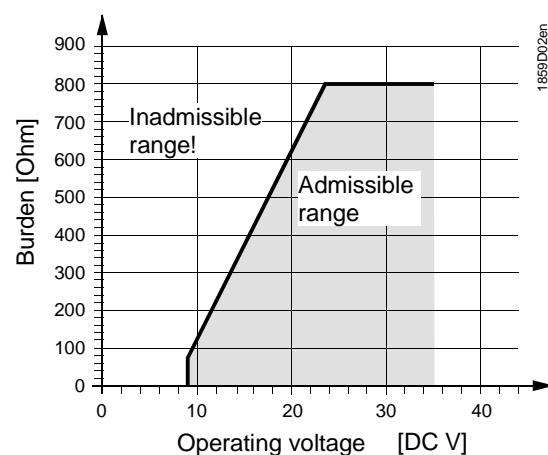

The room sensor consists of housing, printed circuit board, connection terminals, measuring rod and circular connector. The housing consists of 2 parts: Base and removable cover (screwed).

A rubber seal is installed between housing and cover in order to satisfy the requirements of IP 65 degree of protection.

The measuring circuit and the setting element are accommodated on the printed circuit board inside the cover, the connection terminals on the base.


Housing and measuring rod are screwed together.

The sensing elements are located at the end of the measuring rod, protected by a screw-on filter cap.

Cable entry is made via the circular connector, which consists of coupling piece with M16 thread and connector with screwed plug. The coupling piece is secured to the housing and internally wired.

The sensor is designed for wall mounting.

Setting element

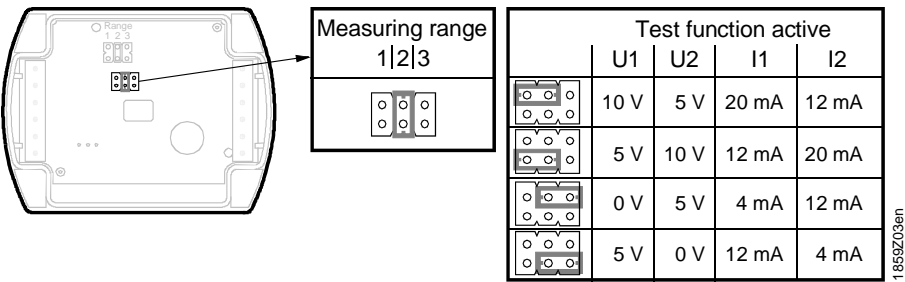

The setting element is located inside the cover. It consists of 6 pins and a shorting plug. It is used for selecting the required temperature measuring range and for activating the test function.

The different shorting plug positions have the following meaning:

- For the active temperature measuring range:
 - Shorting plug in the left position (R1) = $-35...+35\text{ }^{\circ}\text{C}$,
 - Shorting plug in the mid position (R2) = $0...50\text{ }^{\circ}\text{C}$ (factory setting)
 - Shorting plug in the right position (R3) = $-40...+70\text{ }^{\circ}\text{C}$
- For the active test function:
 - Shorting plug in the horizontal position: The values available at the signal output are those given in the table "Test function active"

Behavior in the event of fault

- If the temperature sensor is faulty, the voltage at signal output U2 (I2) is 0 V (4 mA) after 60 seconds, the humidity signal at signal output U1 (I1) increases to 10 V (20 mA)
- If the humidity sensor is faulty, the voltage at signal output U1 (I1) is 10 V (20 mA) after 60 seconds; the temperature signal remains active

Calibration certificates

The sensor and its exchangeable AQF4150 measuring tip are numbered, registered and calibrated prior to delivery. The associated calibration certificates are supplied with the sensor.

Accessories

Name	Type reference
Measuring tip (exchangeable)	AQF4150
Filter cap (for replacement)	AQF3101

Engineering notes

	<p>Use a safety extra low-voltage (SELV) transformer with separate windings designed for 100 % duty. All safety regulations valid at the location of the plant must be observed when sizing and protecting the transformer.</p> <p>When sizing the transformer, the sensor's power consumption must be taken into consideration.</p> <p>For the electrical connection of the sensor, refer to the Data Sheets of the devices with which the sensor is used.</p> <p>The maximum permissible cable lengths must be observed.</p>
Cable routing and cable selection	<p>For cable routing, it should always be considered that electrical interference is the greater, the longer the cables run parallel and the smaller the distance between them. Use shielded cables if necessary.</p> <p>Twisted pairs of cables are required for the secondary supply lines and the signal lines.</p>
Note to QFA4171	<p>Terminals G1(+) and I1(–) for the humidity output must always be connected to power, even if only the temperature output G2(+) and I2(–) is used!</p>

Mounting notes

Mounting location	<p>Inside wall (not on outside wall!) of the room to be air conditioned; not in recesses, shelves, behind curtains, above or close to heat sources; not on walls behind which a chimney is located.</p> <p>The sensor must not be exposed to direct solar radiation.</p> <p>Install the sensor in the occupied space about 1.5 m above the floor and at least 50 cm from the next wall.</p>
<i>Caution!</i>	<ul style="list-style-type: none">• The seal between housing and cover must not be removed, or else degree of protection IP 65 will be no longer ensured.• The sensing elements inside the measuring rod are sensitive to shock and impact. Avoid any such impact on mounting.
Mounting position	<p>The QFA4160 must not be mounted with the measuring rod pointing upward.</p>
Mounting Instructions	<p>Mounting Instructions are printed on the inner side of the package.</p>

Commissioning notes

Prior to switching on power, check wiring.

On the sensor, select the required temperature measuring range.

Recalibration service



	<p>SBT HVAC Products provides a recalibration service for used sensors.</p> <p>Recalibration should be performed at 12-month intervals under "normal" conditions, i.e. within the comfort range for humidity and temperature, and at air contamination levels that are not above average.</p>
Services provided	<p>The recalibration service includes the following:</p> <ul style="list-style-type: none">• Delivery and invoicing of the new AQF4150 measuring tip complete with calibration certificate• Delivery of a calibration certificate for the (old) measuring tip returned to SBT HVAC Products, enabling the customer to assess the time of usage of the measuring tip

Technical data

Power supply	Operating voltage	AC 24 V \pm 20 % or DC 13.5...35 V
	Frequency	50/60 Hz at AC 24 V
	Power consumption	\leq 1 VA
Cable lengths for the measuring signal	Max. perm. cable lengths	refer to Data Sheet of the device handling the signal
Functional data "Humidity sensor"	Measuring range	0...100 % r.h.
	Measuring accuracy at 23 °C and 0...100 % r.h.	\pm 2 %
	Temperature dependency	\leq 0.05 % r.h./°C
	Time constant	approx. 20 s in moving air
	Output signal, linear (terminal U1)	DC 0...10 V $\hat{=}$ 0...100 % r.h., max. \pm 1 mA
	Output signal, linear (terminal I1) Burden	4...20 mA $\hat{=}$ 0...100 % r. h. refer to "Function"
	Measuring range	0...50 °C (R2 = factory setting), -35...+35 °C (R1), -40...+70 °C (R3)
Functional data "Temperature sensor"	Sensing element	Pt 1000 class B to DIN EN 60 751
	Measuring accuracy in the range of 15...35 °C -35...+70 °C	\pm 0.6 K \pm 0.8 K
	Time constant	approx. 20 s in moving air
	Output signal, linear (terminal U2)	DC 0...10 V $\hat{=}$ 0...50/-35...+35/-40...+70 °C \pm 1 mA max.
	Output signal, linear (terminal I2) Burden	4...20 mA $\hat{=}$ 0...50/-35...+35/-40...+70 °C refer to "Function"
	Housing	IP 65 to IEC 529
	Safety class	III to EN 60 730
Electrical connections	Connector with screwed plug	Lumberg RSC 4/9
	Screw terminals for	0.75 mm ² max.
	Cable entry	4...8 mm dia.
Environmental conditions	Operation to	IEC 721-3-3
	Climatic conditions	class 4K2
	Temperature (housing with electronics)	-40...+70 °C
	Humidity	0...100 % r.h. (with condensation)
	Mechanical conditions	class 3M2
	Transport to	IEC 721-3-2
Materials and colors	Climatic condition	class 2K3
	Temperature	-25...+70 °C
	Humidity	<95 % r.h.
	Mechanical conditions	class 2M2
	Base	polycarbonate, RAL 7001 (silver-grey)
	Housing cover	polycarbonate, RAL 7035 (light-grey)
Standards	Scale	polycarbonate, RAL 7001 (silver-grey)
	Filter cap	polycarbonate, RAL 7001 (silver-grey)
	Circular connector	
	Connector with screwed plug	Lumberg RSC 4/9
	Contact carrier and body	PA, black
	Knurled nut and contact	CuZn, nickel-plated
	Coupling piece	Lumberg RKFM 4/0.5 M
	Contact carrier	TPU
	Casing and contact	CuZn, nickel-plated
	Sensor (entirely)	silicon-free
	Packaging	corrugated cardboard
	Product safety	
Standards	Automatic electrical controls for household and similar use	EN 60 730-1
	Electromagnetic compatibility	
	Immunity	EN 61 000-6-1
	Emissions	EN 61 000-6-3
	CE conformity to	EMC directive 89/336/EEC
	Conformity to	
	Australian EMC framework Radio Interference Emission Standard	Radio Communication Act 1992 AS/NZS 3548
Weight	UL conformity	UL 873
	Incl. packaging	0.196 kg



Connection terminals

QFA4160

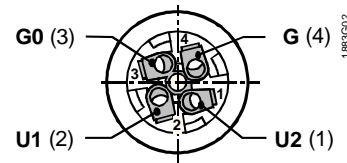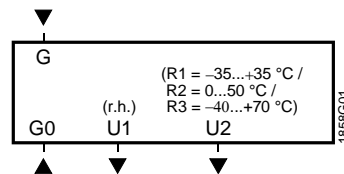

Front view:
Connector fitted,
body removed

QFA4171

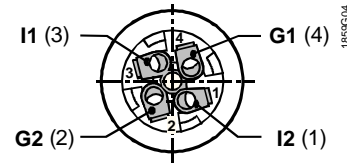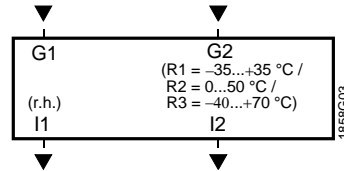


Front view:
Connector fitted,
body removed

G, G0	Operating voltage AC 24 V (SELV) or DC 13.5...35 V
G1, G2	Operating voltage DC 13.5...35 V
U1	Signal output DC 0...10 V for relative humidity 0...100 %
U2	Signal output DC 0...10 V for temperature range 0...50 °C / -40...+70 °C / -35...+35 °C
I1	Signal output 4...20 mA for relative humidity 0...100 %
I2	Signal output 4...20 mA for temperature range 0...50 °C / -40...+70 °C / -35...+35 °C

Note on connection terminals of the QFA4171:

Terminals G1(+) and I1(-) for the humidity output must always be connected to power, even if only the temperature output G2(+) and I2(-) is used!

Dimensions

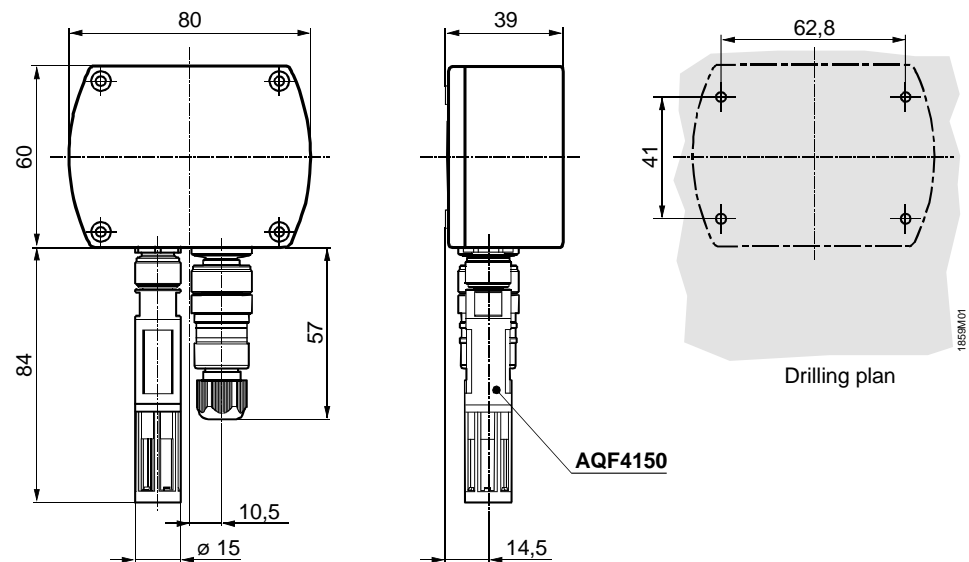

Dimensions in mm